

ENGINEERING DATA

THERMALLY CONDUCTIVE, PATENTED ALUMINUM CORE

The counter-flow heat recovery core transfers heat between the two airstreams. It is easily removed for cleaning or service.

MOTORS AND BLOWERS

Each airstream has an independent motorized impeller with multiple fan speed operations.

FILTERS

Washable air filters in exhaust and supply airstream.

MOUNTING THE HRV

Threaded inserts at corners of the cabinet designed to accept the "S" hooks and hanging straps supplied with the unit.

DEFROST

Recirculating damper defrost system.

CASE

20 gauge prepainted galvanized steel for superior corrosion resistance, insulated to prevent exterior condensation. Drain connection: Two 1/2 in (12 mm) OD. Balancing ports are located on unit.

INSTALLER SELECTABLE HIGH SPEED SETTINGS

Adjustable DIP switches are located on the circuit board, Hi3 is the factory setting. Refer to the Installation manual for the adjustment instructions.

ELECTRONICS

The optional controls can be wall mounted in a central location of the home. 3 wire 20 gauge (min.) 100 ft length (max.).

CONTROL OPTIONS

99-DXPL02 Lifebreath Digital Control

- 5 speed operation on each mode
- Humidity control through adjustable Dehumidistat
- 5 user selectable operational modes: Continuous Ventilation, Continuous Recirculation, 20 ON/40 OFF, 10 ON/50 OFF, 20 ON/40 Recirculation
- 20/40/60 min. High speed override button
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-BC02 Lifebreath Ventilation Control

- 2 speed fan setting (Low/High)
- Humidity control through adjustable Dehumidistat
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-BC03 Lifebreath Ventilation Control

- Continuous Low fan speed
- Humidity control through adjustable Dehumidistat
- 3 modes of operation: Ventilation, Recirculation, 20/40
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-BC04 Lifebreath Ventilation Control

- 2 speed fan setting (Low/High)
- 2 modes of operation: Ventilation, 20/40
- Compatible with 99-DET02 Wireless Timers
- 3 wire connection

99-DH01 Lifebreath Dehumidistat

- Humidity control through adjustable Dehumidistat
- 3 wire connection

TIMER OPTIONS

99-DET01 Lifebreath 20/40/60 Minute Timer - Initiates High speed Ventilation for 20, 40 or 60 minutes. 3 wire connection.

99-DET02 Lifebreath WIRELESS 20/40/60 Minute Timer - Initiates High speed Ventilation for 20, 40 or 60 minutes. Wirelessly connects to main control for ease of installation. 40' approximate range.

99-RX02 Lifebreath WIRELESS Repeater - Used to extend range of 99-DET02 Wireless Timers. Plugs into 120V power outlet. Wirelessly connects to main control and 99-DET02. Install at halfway point between timer and main wall control if timer is out of range.


ACCESSORY OPTIONS

99-163 Duct Heater w/Electronic SCR Thermostat - 1 kW, 6 in (152 mm)

99-186 Weatherhoods - Two 6 in (152 mm)

DIMENSIONS RNC205


WEIGHT 57 lbs (25.8 kg) **SHIPPING WEIGHT** 67 lbs (30 kg)

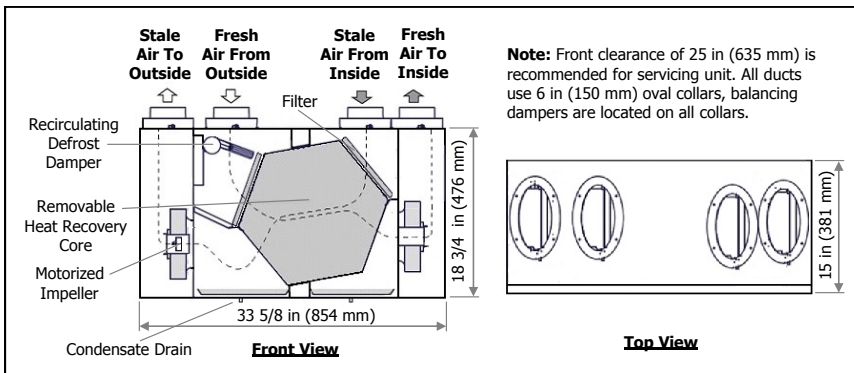

Performance (HVI certified)		
Net supply air flow in cfm (L/s) against external static pressure		
External Static Pressure	Airflow	
@ 0.1 in (25 Pa)	222 cfm (105 L/s)	
@ 0.2 in (50 Pa)	207 cfm (98 L/s)	
@ 0.3 in (75 Pa)	193 cfm (91 L/s)	
@ 0.4 in (100 Pa)	179 cfm (84 L/s)	
@ 0.5 in (125 Pa)	165 cfm (78 L/s)	
@ 0.6 in (150 Pa)	150 cfm (71 L/s)	
@ 0.7 in (175 Pa)	135 cfm (63 L/s)	
@ 0.8 in (200 Pa)	119 cfm (56 L/s)	
@ 0.9 in (225 Pa)	102 cfm (48 L/s)	
@ 1.0 in (250 Pa)	84 cfm (40 L/s)	
Max. Temperature Recovery	81%	
Sensible Effectiveness		
@ 100 cfm (47 L/s)	32°F (0°C)	77%
Sensible Efficiency		
@ 100 cfm (47 L/s)	32°F (0°C)	68%
Sensible Efficiency		
@ 100 cfm (47 L/s)	-13°F (-25°C)	68%
VAC @ 60Hz	120	
Watts / Low speed	64	
Watts / High speed	96	
Amp rating	1.4	

Sensible Efficiency: Thermal Effectiveness: Based on temperature differential between the 2 airstreams

Efficiency: Takes into account all power inputs

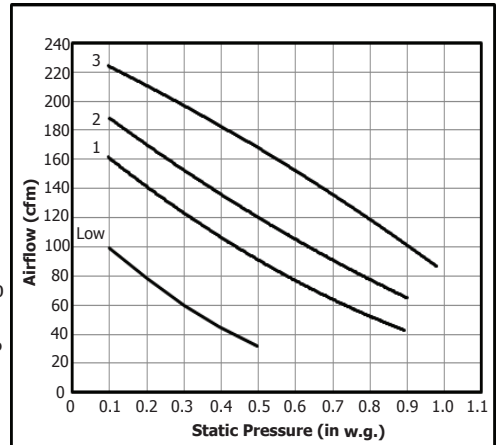

WARRANTY

Units carry a lifetime warranty on the HRV core and a 5 year replacement parts warranty.

NOTE: All specifications are subject to change without notice.

All units conform to CSA and UL standards



Date: _____

Tag: _____ Qty: _____

Project: _____

Engineer: _____

Contractor: _____

Supplier: _____

Quote #: _____

Submitted By: _____